



BVS, Inc - IVDS Detections - 2009042597

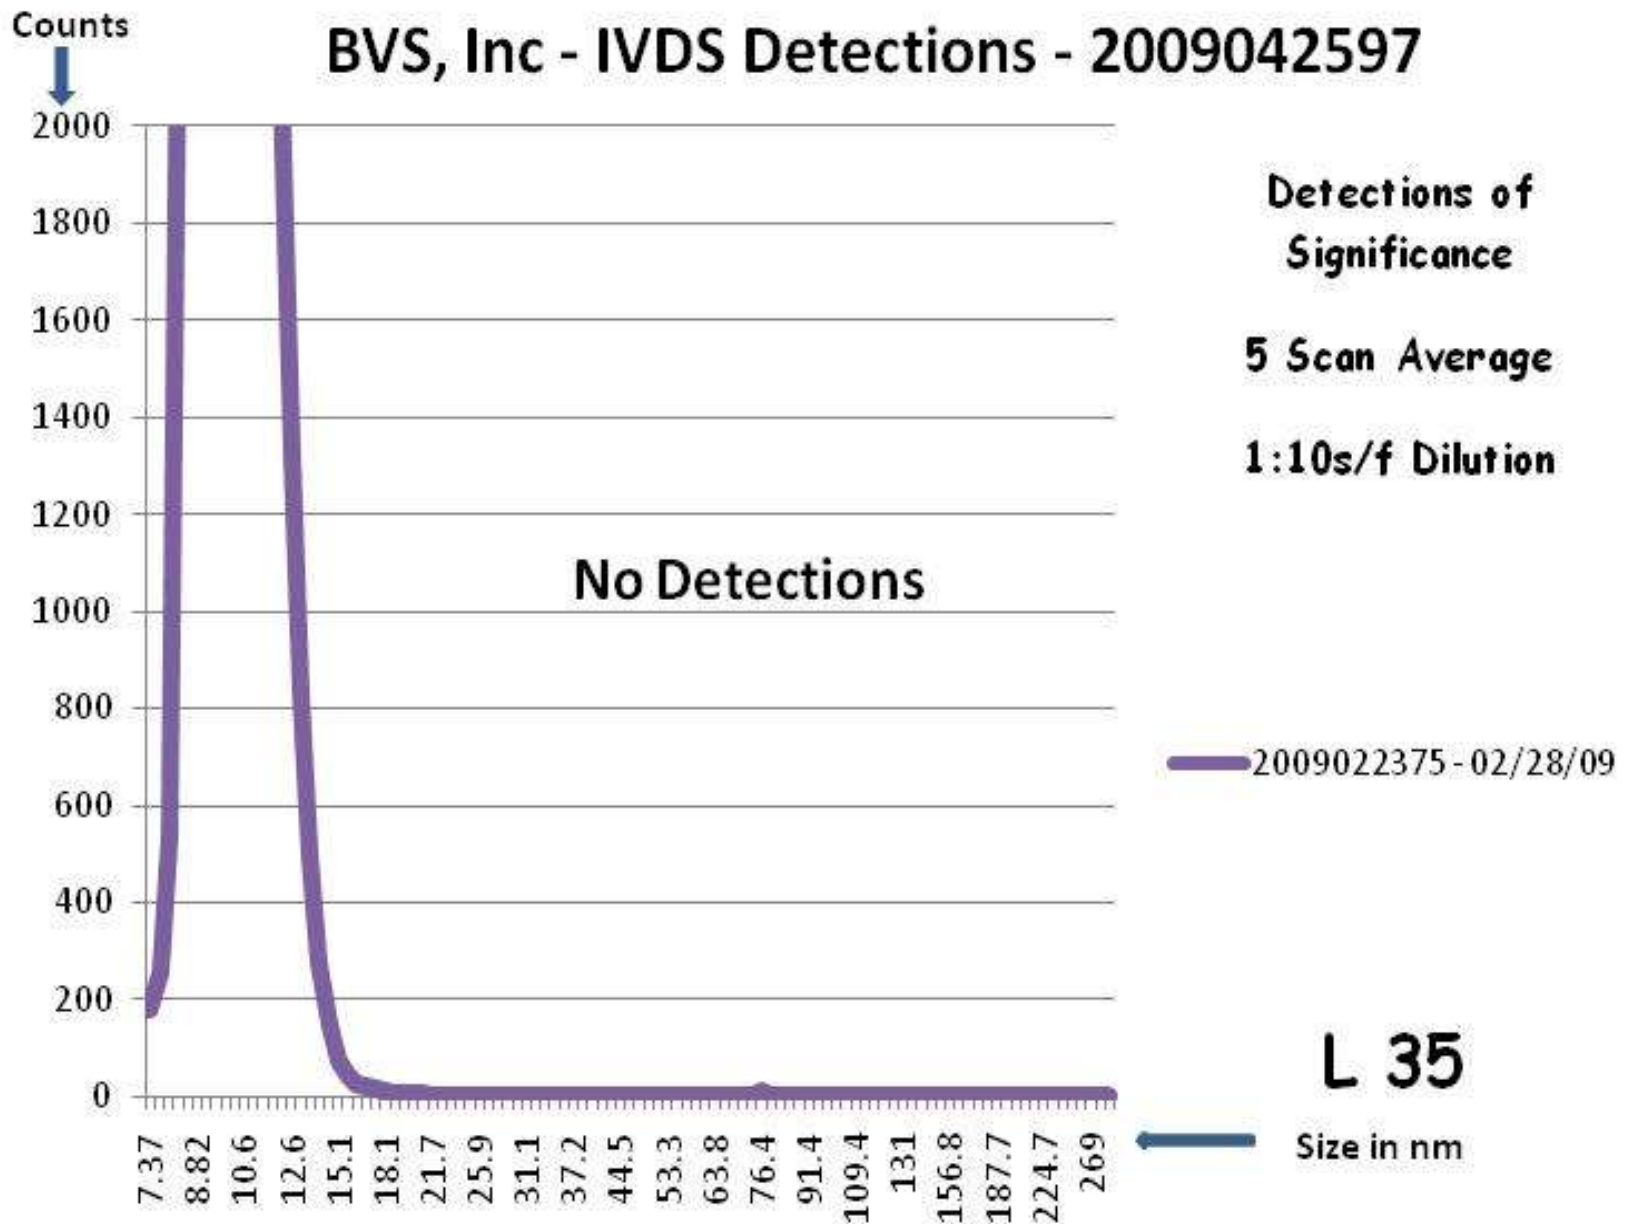

BVS, Inc - IVDS Detections - 2009042597

Counts

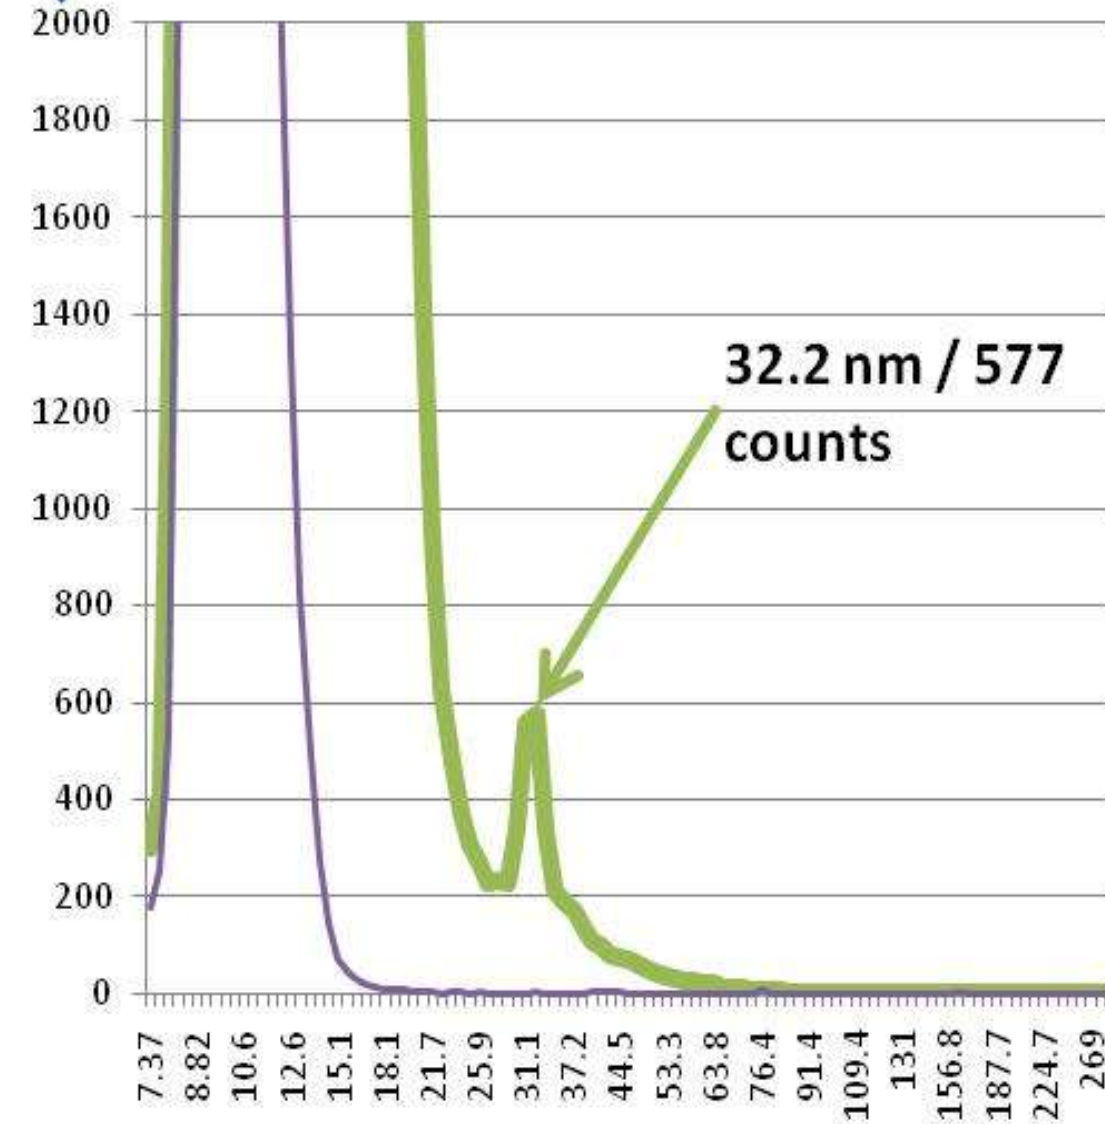

Detections of Significance

5 Scan Average

1:10s/f Dilution


2009032453 - 03/19/09

2009022375 - 02/28/09


L 35

Size in nm


BVS, Inc - IVDS Detections - 2009042597

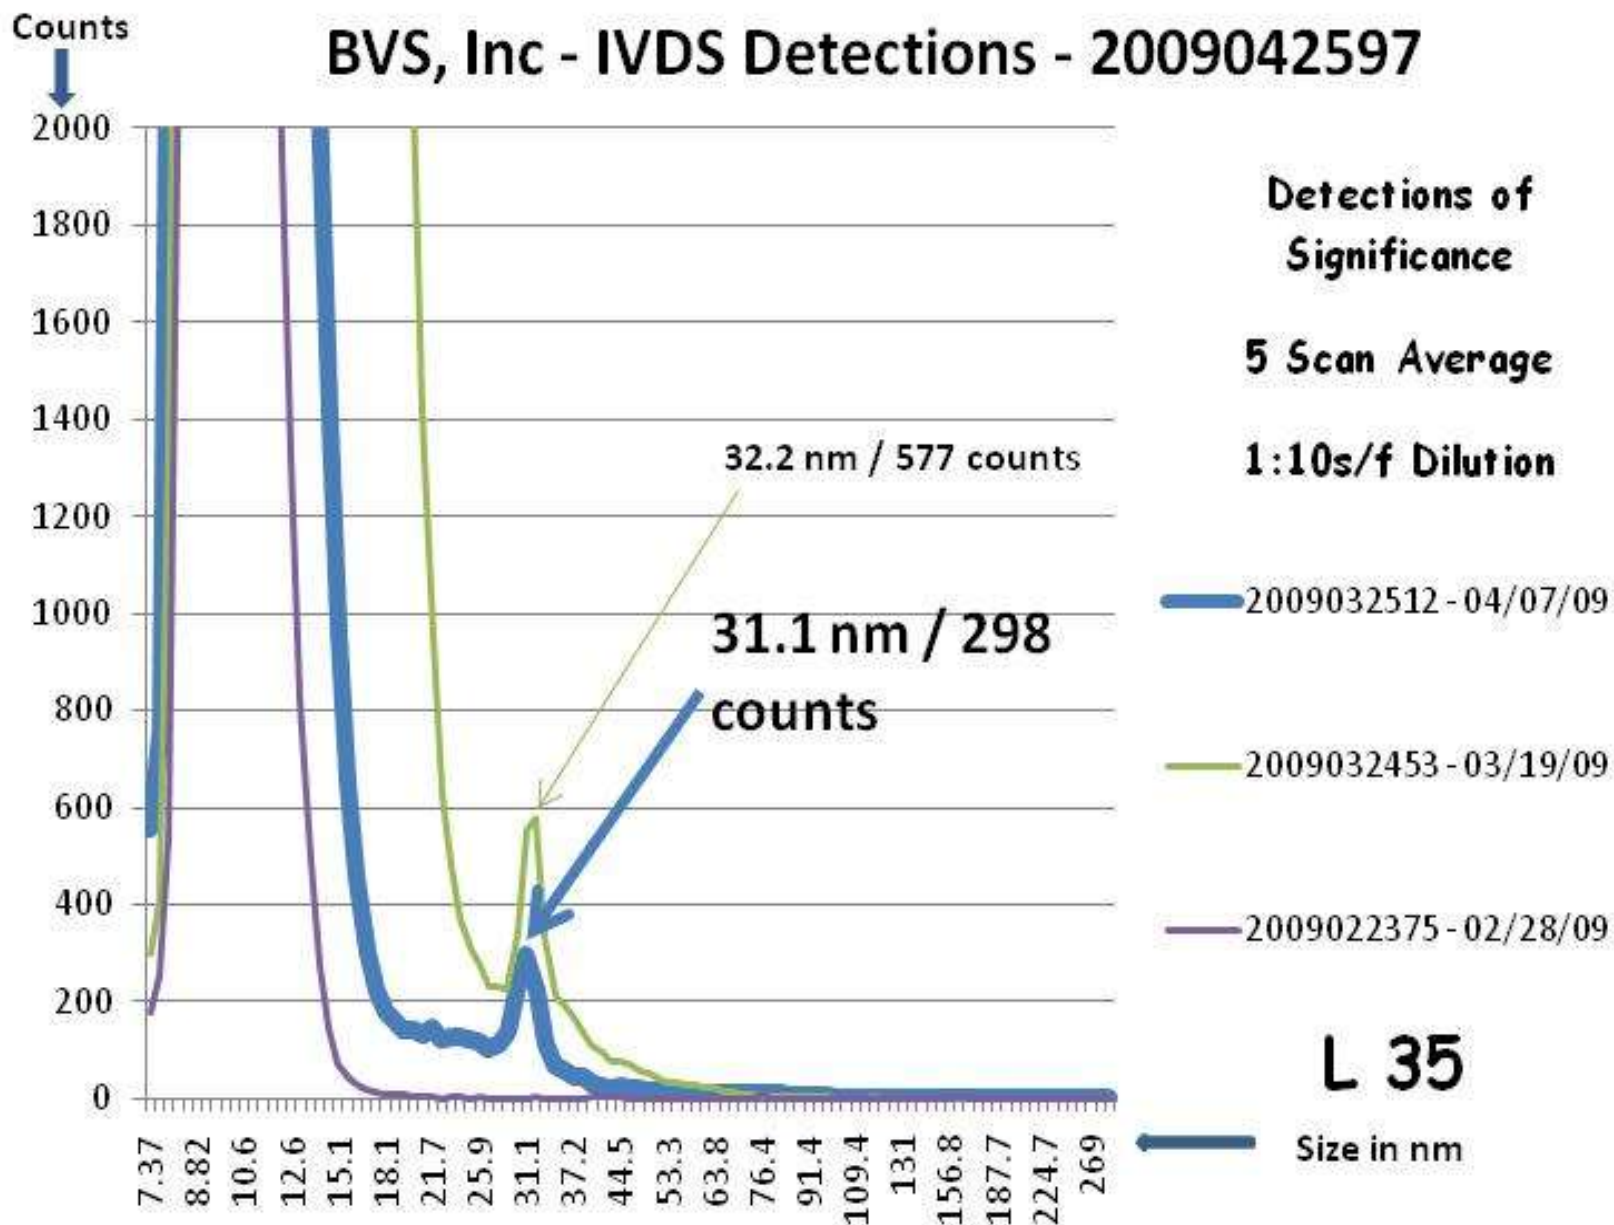


BVS, Inc - IVDS Detections - 2009042597

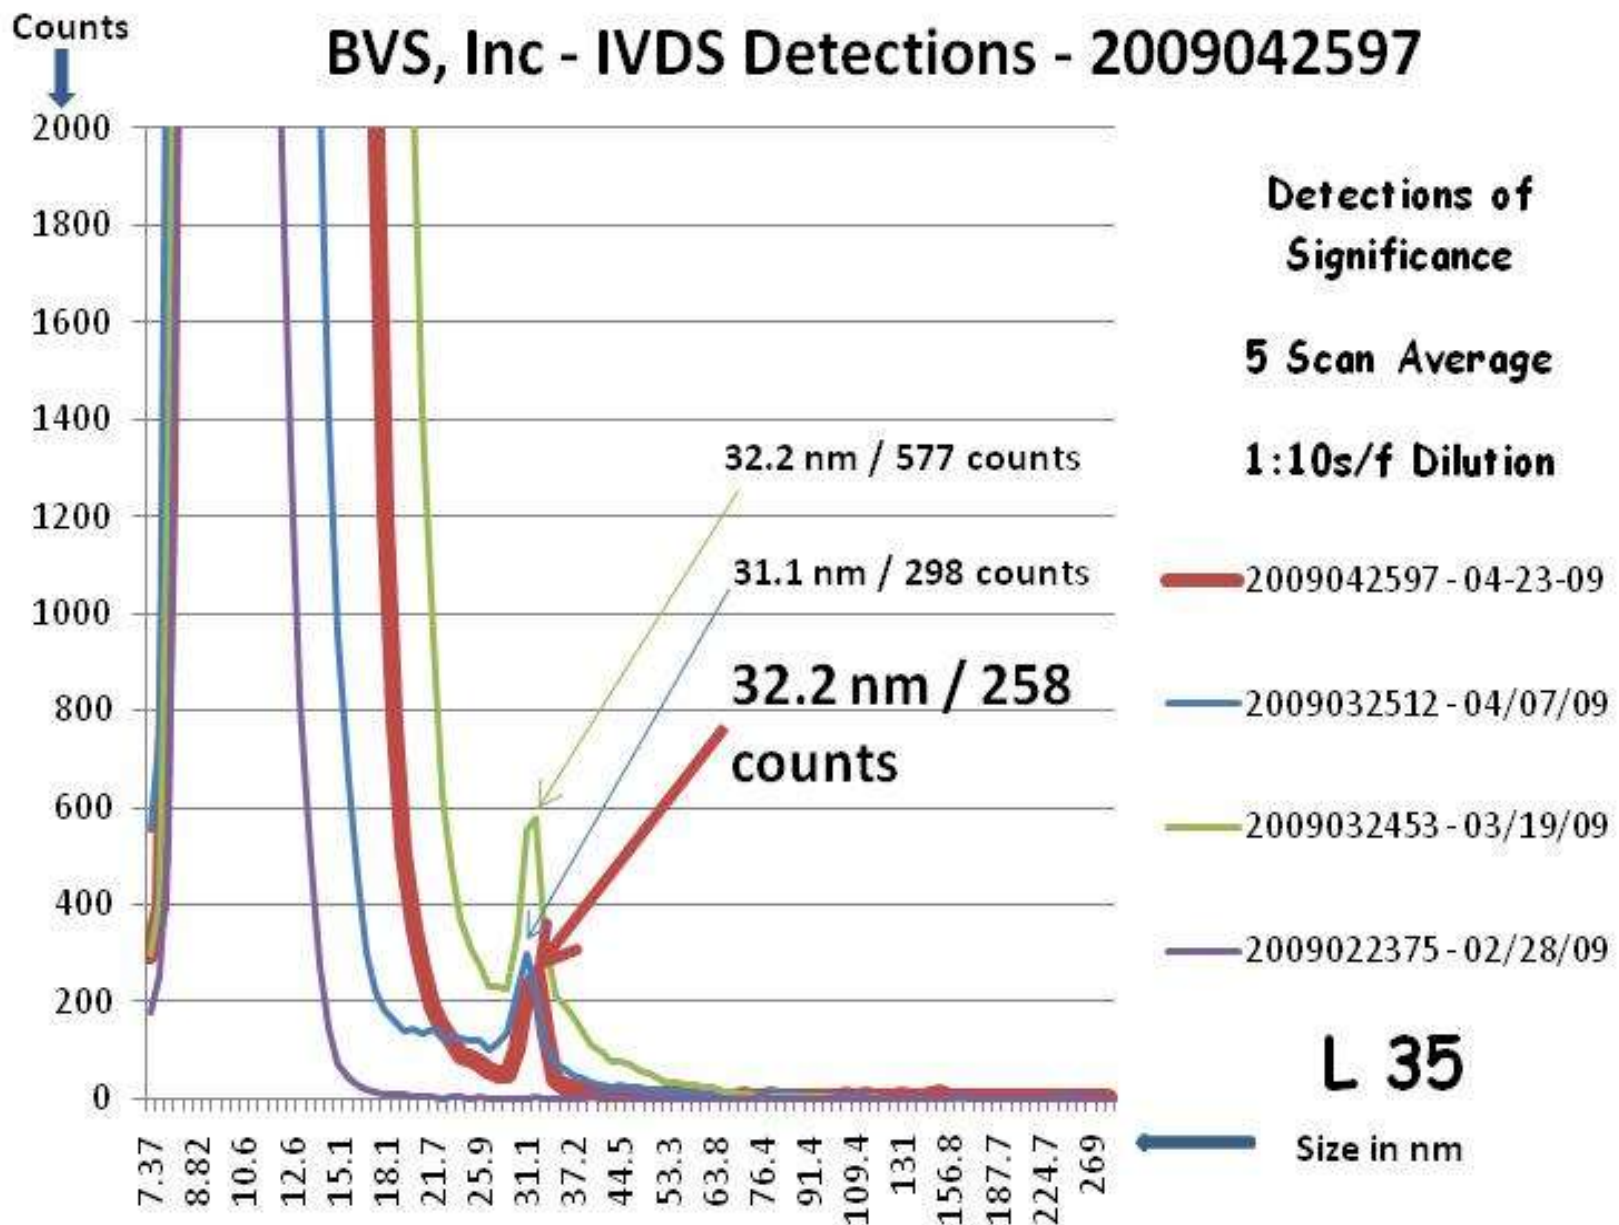

BVS, Inc - IVDS Detections - 2009042597

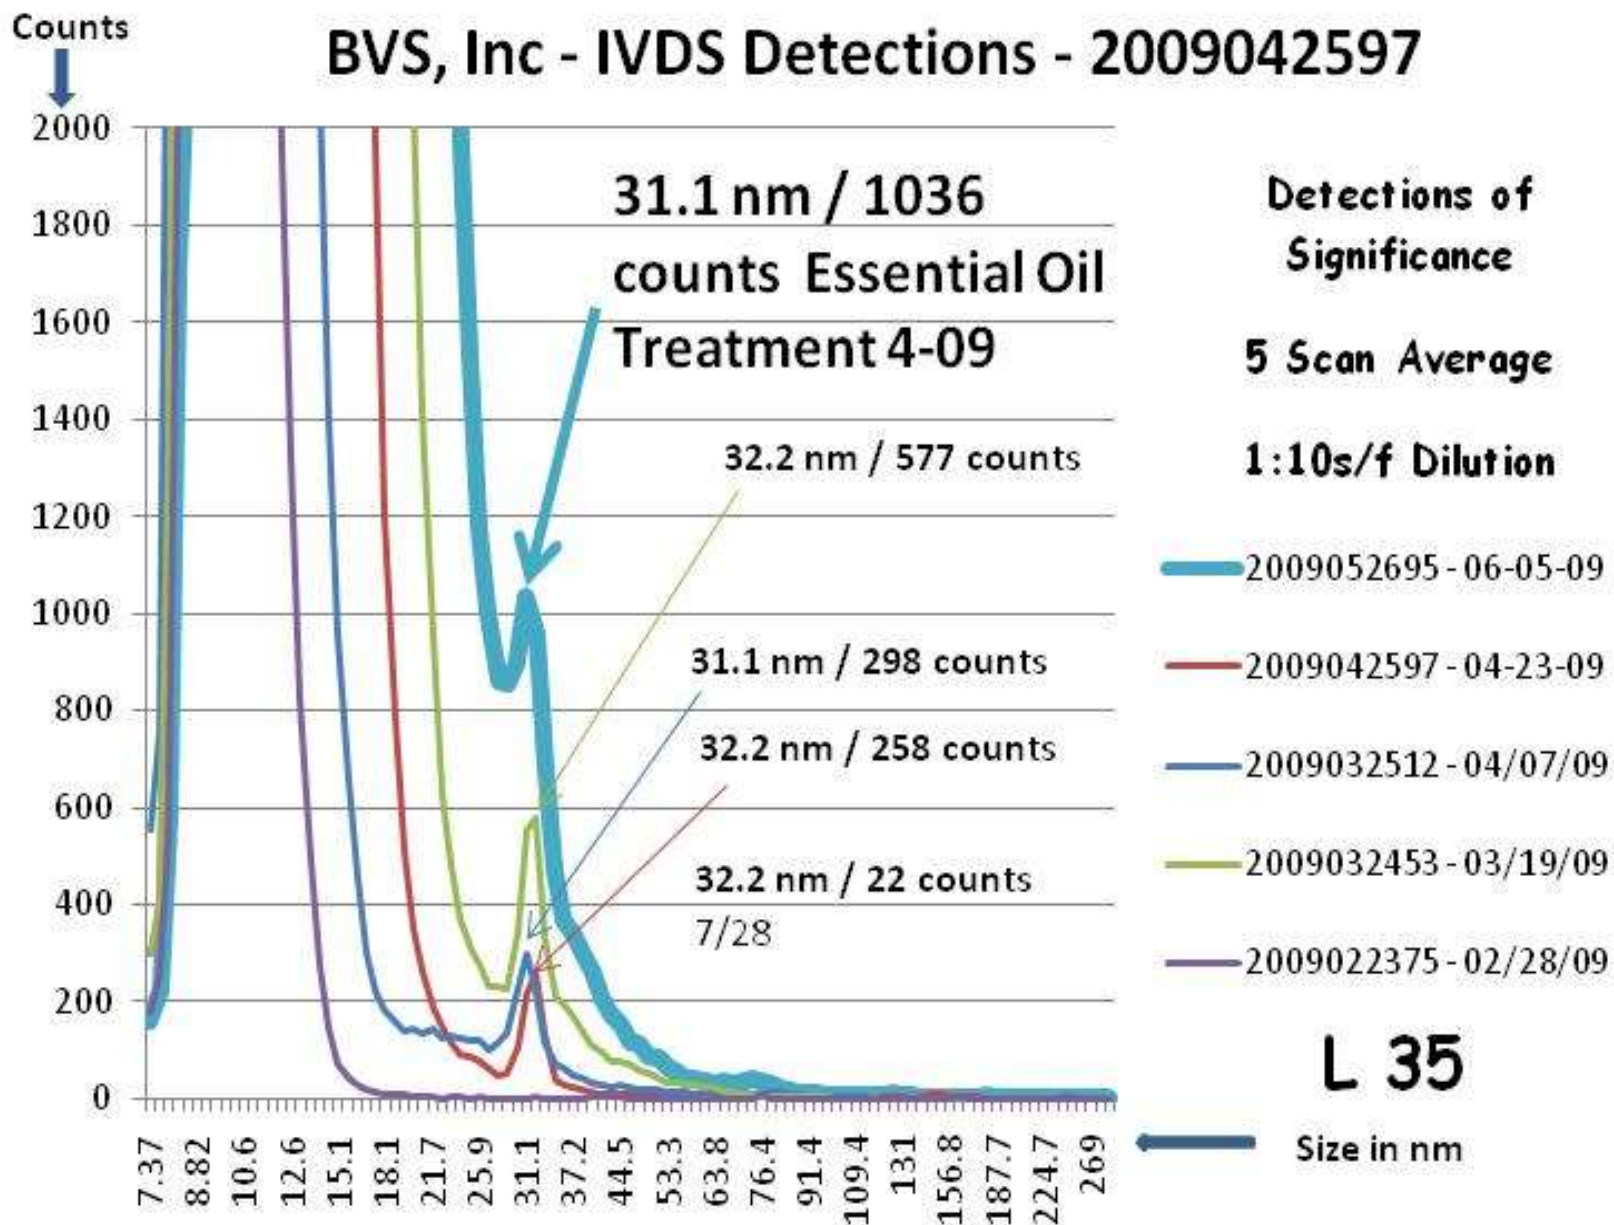

BVS, Inc - IVDS Detections - 2009042597

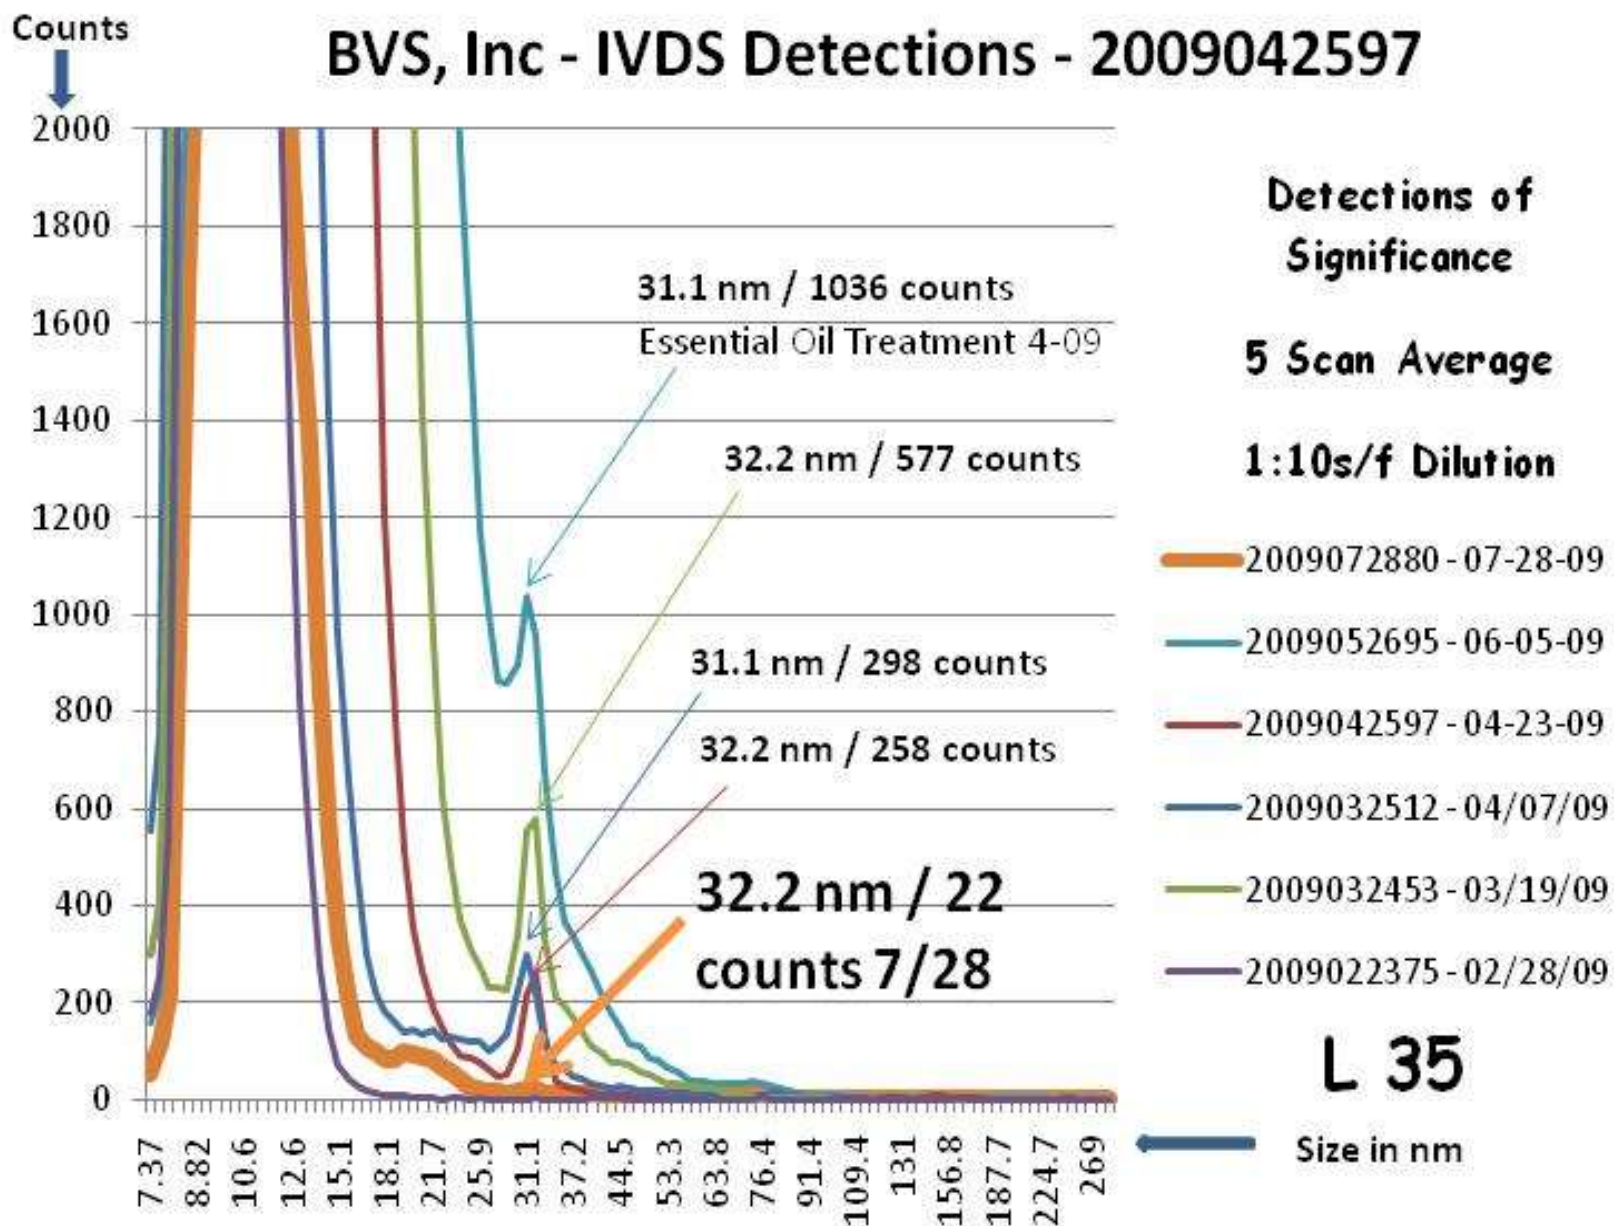

BVS, Inc - IVDS Detections - 2009042597

